

EURAX DME 440 with RS 485 interface

Programmable multi-transducer



for the measurement of electrical variables in heavy-current power system



Application

EURAX DME 440 (Fig. 1) is a programmable transducer with a **RS 485 bus interface (MODBUS®)**. It supervises several variables of an electrical power system **simultaneously** and generates 4 proportional analogue output signals.

The **RS 485** interface enables the user to determine the number of variables to be supervised (up to the maximum available). The levels of all internal energy meters that have been configured (max. 4) can also be viewed. Provision is made for programming the EURAX DME 440 via the bus. A standard EIA 485 interface can be used, but there is no dummy load resistor for the bus.

The transducers are also equipped with an **RS 232** serial interface to which a PC with the corresponding software can be connected for programming or accessing and executing useful ancillary functions. This interface is needed for bus operation to configure the device address, the Baud rate and possibly increasing the telegram waiting time (if the master is too slow) defined in the MODBUS® protocol.

The usual methods of connection, the types of measured variables, their ratings, the transfer characteristic for each output and the type of internal energy meter are the main parameters that can be programmed.

The ancillary functions include a power system check, provision for displaying the measured variables on a PC monitor, the simulation of the outputs for test purposes and a facility for printing nameplates.

The transducer fulfills all the essential requirements and regulations concerning electromagnetic compatibility (**EMC**) and safety (IEC 1010 resp. EN 61 010). It was developed and is manufactured and tested in strict accordance with the **quality assurance standard ISO 9001**.



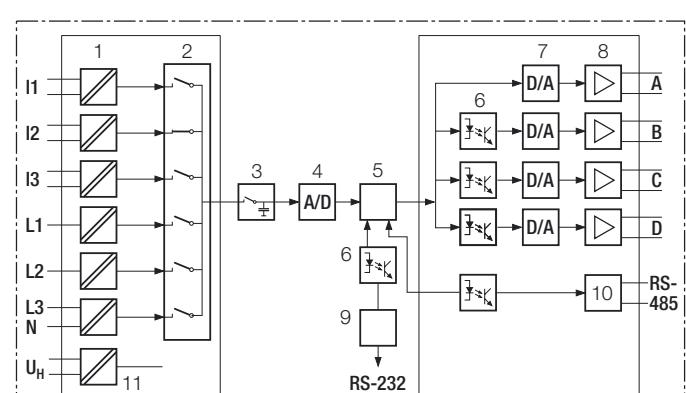
Fig. 1. EURAX DME 440 as plug-in module for 19" rack-mounted case, front plate width **14 TE**.

- For all heavy-current power system variables
- 4 analogue outputs
- Input voltage up to 693 V (phase-to-phase)
- Universal analogue outputs (programmable)
- High accuracy: U/I 0.2%, P 0.25% (under reference conditions)
- 4 integrated energy meters, storage every each 203 s, storage for: 20 years
- Windows software with password protection for programming, data analysis, power system status simulation, acquisition of meter data and making settings
- DC-, AC-power pack with wide power supply tolerance / Universal
- Plug-in module (front plate width 14 TE) for 19" rack-mounted case / Ease of mounting in rack system

Features / Benefits

- Simultaneous measurement of several variables of a heavy-current power system / Full supervision of an asymmetrically loaded four-wire power system, rated current 1 to 6 A, rated voltage 57 to 400 V (phase-to-neutral) resp. 100 to 693 V (phase-to-phase)

Measured variables	Output	Types
Current, voltage (rms), active/reactive/apparent power cosφ, sinφ, power factor RMS value of the current with wire setting range (bimetal measuring function)	4 analogue outputs and bus interface RS 485 (MODBUS)	DME 440
Slave pointer function for the measurement of the RMS value IB Frequency Average value of the currents with sign of the active power (power system only)	2 analogue outputs and 4 digital outputs or 4 analogue outputs and 2 digital outputs see Data Sheet DME 424/442-2 Le	DME 424
		DME 442



- 1 = Input transformer
2 = Multiplexer
3 = Latching stage
4 = A/D converter
5 = Microprocessor
6 = Electrical insulation

- 7 = D/A converter
8 = Output amplifier / Latching stage
9 = Programming interface RS-232
10 = Bus RS 485 (MODBUS)
11 = Power supply

Fig. 2. Block diagram.

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Symbols

Symbols	Meaning	Symbols	Meaning (Continuation)
X	Measured variable	Q	Reactive power of the system $Q = Q_1 + Q_2 + Q_3$
X0	Lower limit of the measured variable	Q1	Reactive power phase 1 (phase-to-neutral L1 – N)
X1	Break point of the measured variable	Q2	Reactive power phase 2 (phase-to-neutral L2 – N)
X2	Upper limit of the measured variable	Q3	Reactive power phase 3 (phase-to-neutral L3 – N)
Y	Output variable	S	Apparent power of the system $S = \sqrt{I_1^2 + I_2^2 + I_3^2} \cdot \sqrt{U_1^2 + U_2^2 + U_3^2}$
Y0	Lower limit of the output variable	S1	Apparent power phase 1 (phase-to-neutral L1 – N)
Y1	Break point of the output variable	S2	Apparent power phase 2 (phase-to-neutral L2 – N)
Y2	Upper limit of the output variable	S3	Apparent power phase 3 (phase-to-neutral L3 – N)
U	Input voltage	Sr	Rated value of the apparent power of the system
Ur	Rated value of the input voltage	PF	Active power factor $\cos\varphi = P/S$
U 12	Phase-to-phase voltage L1 – L2	PF1	Active power factor phase 1 P_1/S_1
U 23	Phase-to-phase voltage L2 – L3	PF2	Active power factor phase 2 P_2/S_2
U 31	Phase-to-phase voltage L3 – L1	PF3	Active power factor phase 3 P_3/S_3
U1N	Phase-to-neutral voltage L1 – N	QF	Reactive power factor $\sin\varphi = Q/S$
U2N	Phase-to-neutral voltage L2 – N	QF1	Reactive power factor phase 1 Q_1/S_1
U3N	Phase-to-neutral voltage L3 – N	QF2	Reactive power factor phase 2 Q_2/S_2
UM	Average value of the voltages $(U_{1N} + U_{2N} + U_{3N}) / 3$	QF3	Reactive power factor phase 3 Q_3/S_3
I	Input current	LF	Power factor of the system $LF = \text{sgn}Q \cdot (1 - PF)$
I1	AC current L1	LF1	Power factor phase 1 $\text{sgn}Q_1 \cdot (1 - PF1)$
I2	AC current L2	LF2	Power factor phase 2 $\text{sgn}Q_2 \cdot (1 - PF2)$
I3	AC current L3	LF3	Power factor phase 3 $\text{sgn}Q_3 \cdot (1 - PF3)$
Ir	Rated value of the input current	c	Factor for the intrinsic error
IM	Average value of the currents $(I_1 + I_2 + I_3) / 3$	R	Output load
IMS	Average value of the currents and sign of the active power (P)	Rn	Rated burden
IB	RMS value of the current with wire setting range (bimetal measuring function)	H	Power supply
IBT	Response time for IB	Hn	Rated value of the power supply
BS	Slave pointer function for the measurement of the RMS value IB	CT	c.t. ratio
BST	Response time for BS	VT	v.t. ratio
φ	Phase-shift between current and voltage		
F	Frequency of the input variable		
Fn	Rated frequency		
P	Active power of the system $P = P_1 + P_2 + P_3$		
P1	Active power phase 1 (phase-to-neutral L1 – N)		
P2	Active power phase 2 (phase-to-neutral L2 – N)		
P3	Active power phase 3 (phase-to-neutral L3 – N)		

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Applicable standards and regulations

IEC 688 or
EN 60 688

Electrical measuring transducers for converting AC electrical variables into analogue and digital signals

IEC 1010 or
EN 61 010

Safety regulations for electrical measuring, control and laboratory equipment

IEC 529 or
EN 60 529

Protection types by case (code IP)

IEC 255-4 Part E5

High-frequency disturbance test (static relays only)

IEC 1000-4-2/-3/-4/-6

Electromagnetic compatibility for industrial-process measurement and control equipment

EN 55 011

Electromagnetic compatibility of data processing and telecommunication equipment

Limits and measuring principles for radio interference and information equipment

IEC 68-2-1/-2/-3/-6/-27

or

EN 60 068-2-1/-2/-3/-6/-27

Ambient tests
-1 Cold, -2 Dry heat,
-3 Damp heat, -6 Vibration,
-27 Shock

DIN 40 110

AC quantities

DIN 43 807

Terminal markings

IEC 1036

Alternating current static watt-hour meters for active energy (classes 1 and 2)

DIN 43 864

Current interface for the transmission of impulses between impulse encoder counter and tarif meter

UL 94

Tests for flammability of plastic materials for parts in devices and appliances

Consumption:

Voltage circuit: $\leq U^2 / 400 \text{ k}\Omega$

Condition:

external power supply

Current circuit: $\leq I^2 \cdot 0.01 \Omega$

Continuous thermal ratings of inputs

Current circuit	10 A 400 V single-phase AC system 693 V three-phase system
Voltage circuit	480 V single-phase AC system 831 V three-phase system

Short-time thermal rating of inputs

Input variable	Number of inputs	Duration of overload	Interval between two overloads
Current circuit	400 V single-phase AC system 693 V three-phase system		
100 A	5	3 s	5 min.
250 A	1	1 s	1 hour
Voltage circuit	1 A, 2 A, 5 A		
Single-phase AC system 600 V $H_{\text{intern}}: 1.5 \text{ Ur}$	10	10 s	10 s
Three-phase system 1040 V $H_{\text{intern}}: 1.5 \text{ Ur}$	10	10 s	10 s

MODBUS® (Bus interface RS-485)

Terminals:	GND on pin 2d Tx- / Rx- on pin 6z Tx+ / Rx+ on pin 6d (see Fig. 6)
Connecting cable:	Screened twisted pair
Max. distance:	Approx. 1200 m (approx. 4000 ft.)
Baudrate:	1200 ... 9600 Bd (programmable)
Number of bus stations:	32 (including master)
Dummy load:	Not required

Technical data

Inputs →

Input variables: see Table 2 and 3

Measuring ranges: see Table 2 and 3

Waveform: Sinusoidal

Rated frequency: 50...60 Hz; 16 2/3 Hz

MODBUS® is a registered trademark of the Schneider Automation Inc.

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Analogue outputs

For the outputs A, B, C and D:

Output variable Y	Impressed DC current	Impressed DC voltage
Full scale Y2	see "Ordering information"	see "Ordering information"
Limits of output signal for input overload and/or $R = 0$	$1.25 \cdot Y_2$	40 mA
$R \rightarrow \infty$	30 V	$1.25 Y_2$
Rated useful range of output load	$0 \leq \frac{7.5 \text{ V}}{Y_2} \leq \frac{15 \text{ V}}{Y_2}$	$\frac{Y_2}{2 \text{ mA}} \leq \frac{Y_2}{1 \text{ mA}} \leq \infty$
AC component of output signal (peak-to-peak)	$\leq 0.005 Y_2$	$\leq 0.005 Y_2$

The outputs A, B, C and D may be either short or open-circuited. They are electrically insulated from each other and from all other circuits (floating).

All the full-scale output values can be reduced subsequently using the programming software, but a supplementary error results.

The hardware full-scale settings for the analogue outputs may also be changed subsequently. Conversion of a current to a voltage output or vice versa is also possible. This necessitates changing resistors on the output board. The full-scale values of the current and voltage outputs are set by varying the effective value of two parallel resistors (better resolution). The values of the resistors are selected to achieve the minimum absolute error. Calibration with the programming software is always necessary following conversion of the outputs. Refer to the Operating Instructions. **Caution: The warranty is void if the device is tampered with!**

System response

Accuracy class: (the reference value is the full-scale value Y_2)

Measured variable	Condition	Accuracy class*
System: Active, reactive and apparent power	$0.5 \leq X_2/S_r \leq 1.5$ $0.3 \leq X_2/S_r < 0.5$	0.25 c 0.5 c
Phase: Active, reactive and apparent power	$0.167 \leq X_2/S_r \leq 0.5$ $0.1 \leq X_2/S_r < 0.167$	0.25 c 0.5 c
	$0.5 S_r \leq S \leq 1.5 S_r$, $(X_2 - X_0) = 2$	0.25 c
	$0.5 S_r \leq S \leq 1.5 S_r$, $1 \leq (X_2 - X_0) < 2$	0.5 c
	$0.5 S_r \leq S \leq 1.5 S_r$, $0.5 \leq (X_2 - X_0) < 1$	1.0 c
	$0.1 S_r \leq S < 0.5 S_r$, $(X_2 - X_0) = 2$	0.5 c
	$0.1 S_r \leq S < 0.5 S_r$, $1 \leq (X_2 - X_0) < 2$	1.0 c
	$0.1 S_r \leq S < 0.5 S_r$, $0.5 \leq (X_2 - X_0) < 1$	2.0 c
AC voltage	$0.1 U_r \leq U \leq 1.2 U_r$	0.2 c
AC current/current averages	$0.1 I_r \leq I \leq 1.5 I_r$	0.2 c
System frequency	$0.1 U_r \leq U \leq 1.2 U_r$ resp. $0.1 I_r \leq I \leq 1.5 I_r$	$0.15 + 0.03 \text{ c}$ ($f_N = 50 \dots 60 \text{ Hz}$) $0.15 + 0.1 \text{ c}$ ($f_N = 16 2/3 \text{ Hz}$)
Energy meter	acc. to IEC 1036 $0.1 I_r \leq I \leq 1.5 I_r$	1.0

* Basic accuracy 0.5 c for applications with phase-shift

Reference conditions

Ambient temperature:	15 ... 30 °C
Pre-conditioning:	30 min. acc. to EN 60 688 Section 4.3, Table 2
Input variable:	Rated useful range
Power supply:	$H = H_n \pm 1\%$
Active/reactive factor:	$\cos \varphi = 1$ resp. $\sin \varphi = 1$
Frequency:	50 ... 60 Hz, 16 2/3 Hz
Waveform:	Sinusoidal, form factor 1.1107
Output load:	DC current output: $R_n = \frac{7.5 \text{ V}}{Y_2} \pm 1\%$
	DC voltage output: $R_n = \frac{Y_2}{1 \text{ mA}} \pm 1\%$
Miscellaneous:	EN 60 688

Duration of the measurement cycle: Approx. 0.5 to s 1.2 s at 50 Hz, depending on measured variable and programming

Response time: 1 ... 2 times the measurement cycle

Factor c (the highest value applies):

Linear characteristic: $X_0 \leq X \leq X_2$	$c = \frac{1 - \frac{Y_0}{Y_2}}{1 - \frac{X_0}{X_2}}$ or $c = 1$
Bent characteristic: $X_1 < X \leq X_2$	$c = \frac{Y_1 - Y_0}{X_1 - X_0} \cdot \frac{X_2}{Y_2}$ or $c = 1$ $c = \frac{1 - \frac{Y_1}{Y_2}}{1 - \frac{X_1}{X_2}}$ or $c = 1$

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

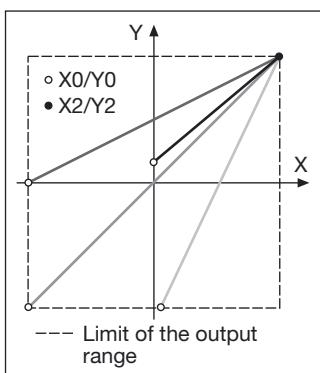


Fig. 3. Examples of settings with linear characteristic.

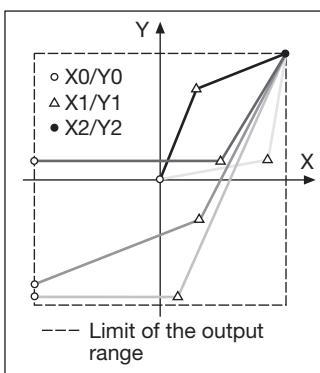



Fig. 4. Examples of settings with bent characteristic.

Programming connector on transducer

Interface: RS 232 C

DSUB socket: 9-pin



The interface is electrically insulated from all other circuits.

Installation data

Housing: Plug-in module for 19" rack-mounted case, Euro format 100×160 mm

Space requirements: 14 TE (70.82 mm) (see section "Dimensional drawing")

Front plate colour: Grey RAL 7032

Designation: EURAX DME 4

Mounting position: Any

Electrical connections: Two 32-pole plugs acc. to DIN 41 612, pattern F and 6-pole plug (contact fitting see section "Electrical connections")

Coding: By coding pins, removed / not removed, see section "Electrical connections"

Weight: Approx. 0.7 kg

Ambient tests

EN 60 068-2-6: Vibration

Acceleration: $\pm 2 \text{ g}$

Frequency range: 10 ... 150 ... 10 Hz, rate of frequency sweep: 1 octave/minute

Number of cycles: 10, in each of the three axes

EN 60 068-2-27: Shock

Acceleration: 3 × 50 g
3 shocks each in 6 directions

EN 60 068-2-1/-2/-3: Cold, dry heat, damp heat

Ambient conditions

Variations due to ambient temperature: $\pm 0.2\% / 10 \text{ K}$

Nominal range of use for temperature: 0...15...30...45 °C (usage group II)

Operating temperature: -10 to +55 °C

Storage temperature: -40 to +85 °C

Annual mean relative humidity: $\leq 75\%$

Altitude: 2000 m max.

Indoor use statement!

Influencing quantities and permissible variations

Acc. to IEC 688

Safety

Protection class: II

Installation category: III

Insulation test (versus earth): Input voltage: AC 400 V
Input current: AC 400 V

Output: DC 40 V

Power supply: AC 400 V
DC 230 V

Surge test: 5 kV; 1.2/50 μs ; 0.5 Ws

Test voltage: 50 Hz, 1 min. acc. to EN 61 010-1

5550 V, inputs versus all other circuits as well as outer surface

3250 V, input circuits versus each other

3700 V, power supply versus outputs and SCI as well as outer surface

490 V, outputs and SCI versus each other and versus outer surface

Power supply →○

AC/DC power pack (DC and 50 ... 60 Hz)

Table 1: Rated voltages and tolerances

Rated voltage U_N	Tolerance
24 ... 60 V DC/AC	DC -15 ... +33%
85 ... 230 V DC/AC	AC $\pm 10\%$

Consumption: $\leq 9 \text{ W resp. } \leq 10 \text{ VA}$

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Table 2: Ordering Information

DESCRIPTION	MARKING	
1. Mechanical design Plug-in module for 19" rack-mounted case		440 - 2
2. Rated frequency		
1) 50 Hz (60 Hz possible without additional error; 16 2/3 Hz, additional error $1.25 \cdot c$)		1
2) 60 Hz (50 Hz possible without additional error; 16 2/3 Hz, additional error $1.25 \cdot c$)		2
3) 16 2/3 Hz (not re-programming by user, 50/60 Hz possible, but with additional error $1.25 \cdot c$)		3
3. Power supply		
7) Nominal range 24 ... 60 V DC, AC		7
8) Nominal range 85 ... 230 V DC, AC		8
4. Power supply connection		
1) External (standard)		1
5. Full-scale output signal, output A		
1) Output A, Y2 = 20 mA (standard)		1
9) Output A, Y2 [mA]		9
Z) Output A, Y2 [V]		Z
Line 9: Full-scale current Y2 [mA] 1 to 20		
Line Z: Full-scale voltage Y2 [V] 1 to 10		
6. Full-scale output signal, output B		
1) Output B, Y2 = 20 mA (standard)		1
9) Output B, Y2 [mA]		9
Z) Output B, Y2 [V]		Z
7. Full-scale output signal, output C		
1) Output C, Y2 = 20 mA (standard)		1
9) Output C, Y2 [mA]		9
Z) Output C, Y2 [V]		Z
8. Full-scale output signal, output D		
1) Output D, Y2 = 20 mA (standard)		1
9) Output D, Y2 [mA]		9
Z) Output D, Y2 [V]		Z
9. Test certificate		
0) None supplied		0
1) Supplied		1
10. Configuration		
0) Basic configuration, programmed		0
9) According to specification		9
Line 9: All the programming data must be entered on Form W 2402e (see appendix) and the form must be included with the order.		

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Table 3: Programming

DESCRIPTION	A11 ... A16	Application	
		A34	A24 / A44
1. Application (system)			
Single-phase AC	A11	—	—
3-wire, 3-phase symmetric load, phase-shift U: L1-L2, I: L1 *	A12	—	—
3-wire, 3-phase symmetric load	A13	—	—
4-wire, 3-phase symmetric load	A14	—	—
3-wire, 3-phase symmetric load, phase-shift U: L3-L1, I: L1 *	A15	—	—
3-wire, 3-phase symmetric load, phase-shift U: L2-L3, I: L1 *	A16	—	—
3-wire, 3-phase asymmetric load	—	A34	—
4-wire, 3-phase asymmetric load	—	—	A44
4-wire, 3-phase asymmetric load, open-Y	—	—	A24
2. Rated input voltage			
Rated value Ur = 57.7 V	U01	—	—
Rated value Ur = 63.5 V	U02	—	—
Rated value Ur = 100 V	U03	—	—
Rated value Ur = 110 V	U04	—	—
Rated value Ur = 120 V	U05	—	—
Rated value Ur = 230 V	U06	—	—
Rated value Ur [V]	U91	—	—
Rated value Ur = 100 V	U21	U21	U21
Rated value Ur = 110 V	U22	U22	U22
Rated value Ur = 115 V	U23	U23	U23
Rated value Ur = 120 V	U24	U24	U24
Rated value Ur = 400 V	U25	U25	U25
Rated value Ur = 500 V	U26	U26	U26
Rated value Ur [V]	U93	U93	U93
Lines U01 to U06: Only for single phase AC current or 4-wire, 3-phase symmetric load			
Line U91: Ur [V] 57 to 400			
Line U93: Ur [V] > 100 to 693			
3. Rated input current			
Rated value Ir = 1 A V1	V1	V1	
Rated value Ir = 2 A V2	V2	V2	
Rated value Ir = 5 A V3	V3	V3	
Rated value Ir > 1 to 6 [A]	V9	V9	V9
4. Primary rating (voltage and current transformer)			
Without specification of primary rating	W0	W0	W0
VT = <input type="text"/> kV CT = <input type="text"/> A	W9	W9	W9
Line W9: Specify transformer ratio primary, e.g. 33 kV, 1000 A The secondary ratings must correspond to the rated input voltage and current specified for feature 2, respectively 3.			

* Basic accuracy 0.5 c

Table 3 continued on next page!

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Continuation "Table 3: Programming"

DESCRIPTION			Application A11 ... A16	Application A34	Application A24 / A44
5. Measured variable, output A					
Not used			AA000	AA000	AA000
Initial value X0	Final value X2				
U System	X0 = 0	X2 = Ur	AA001	—	—
U12 L1-L2	X0 = 0	X2 = Ur	—	AA001	AA001
U System	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur ≤ X2 ≤ 1.2 · Ur	AA901	—	—
U1N L1-N	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur/V3 ≤ X2 ≤ 1.2 · Ur/V3	—	—	AA902
U2N L2-N	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur/V3 ≤ X2 ≤ 1.2 · Ur/V3	—	—	AA903
U3N L3-N	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur/V3 ≤ X2 ≤ 1.2 · Ur/V3	—	—	AA904
U12 L1-L2	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur ≤ X2 ≤ 1.2 · Ur	—	AA905	AA905
U23 L2-L3	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur ≤ X2 ≤ 1.2 · Ur	—	AA906	AA906
U31 L3-L1	0 ≤ X0 ≤ 0.9 · X2	0.8 · Ur ≤ X2 ≤ 1.2 · Ur	—	AA907	AA907
I System	0 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	AA908	—	—
I1 L1	0 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA909	AA909
I2 L2	0 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA910	AA910
I3 L3	0 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA911	AA911
P System	-X2 ≤ X0 ≤ 0.8 · X2	0.3 ≤ X2 / Sr ≤ 1.5	AA912	AA912	AA912
P1 L1	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA913
P2 L2	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA914
P3 L3	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA915
Q System	-X2 ≤ X0 ≤ 0.8 · X2	0.3 ≤ X2 / Sr ≤ 1.5	AA916	AA916	AA916
Q1 L1	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA917
Q2 L2	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA918
Q3 L3	-X2 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA919
PF System	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	AA920	AA920	AA920
PF1 L1	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA921
PF2 L2	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA922
PF3 L3	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA923
QF System	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	AA924	AA924	AA924
QF1 L1	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA925
QF2 L2	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA926
QF3 L3	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA927
F	15.3 Hz ≤ X0 ≤ X2 - 1 Hz	X0 + 1 Hz ≤ X2 ≤ 65 Hz	AA928	AA928	AA928
S System	0 ≤ X0 ≤ 0.8 · X2	0.3 ≤ X2 / Sr ≤ 1.5	AA929	AA929	AA929
S1 L1	0 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA930
S2 L2	0 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA931
S3 L3	0 ≤ X0 ≤ 0.8 · X2	0.1 ≤ X2 / Sr ≤ 0.5	—	—	AA932
IM System	0 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA933	AA933
IMS System	-X2 ≤ X0 ≤ 0.8 · X2	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA934	AA934
LF System	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	AA935	AA935	AA935
LF1 L1	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA936
LF2 L2	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA937
LF3 L3	-1 ≤ X0 ≤ (X2 - 0.5)	0 ≤ X2 ≤ 1	—	—	AA938
IB System	X0 = 0 1 ≤ IBT ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	AA939	—	—
IB1 L1	X0 = 0 1 ≤ IBT ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA940	AA940
IB2 L2	X0 = 0 1 ≤ IBT ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA941	AA941
IB3 L3	X0 = 0 1 ≤ IBT ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA942	AA942
BS System	X0 = 0 1 ≤ BST ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	AA943	—	—
BS1 L1	X0 = 0 1 ≤ BST ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA944	AA944
BS2 L2	X0 = 0 1 ≤ BST ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA945	AA945
BS3 L3	X0 = 0 1 ≤ BST ≤ 30 min	0.5 · Ir ≤ X2 ≤ 1.5 · Ir	—	AA946	AA946
UM System	0 ≤ X0 ≤ 0.8 · X2	0.8 · Ur ≤ X2 ≤ 1.2 · Ur	—	—	AA947

Table 3 continued on next page!

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Continuation "Table 3: Programming"

DESCRIPTION	A11 ... A16	Application A34	A24 / A44
6. Output signal, output A Initial value Y0 Final value Y2 DC current Y0 = 0 Y2 = 20 mA -Y2 ≤ Y0 ≤ 0.2 · Y2 1 mA ≤ Y2 ≤ 20 mA DC voltage -Y2 ≤ Y0 ≤ 0.2 · Y2 1 V ≤ Y2 ≤ 10 V	AB01 AB91 AB92	AB01 AB91 AB92	AB01 AB91 AB92
7. Characteristic, output A Linear Bent (X0 + 0.015 · X2) ≤ X1 ≤ 0.985 · X2 Y0 ≤ Y1 ≤ Y2	AC01 AC91	AC01 AC91	AC01 AC91
8. Limits, output A Standard Ymin = Y0 – 0.25 Y2 Ymax = 1.25 Y2 (Y0 – 0.25 Y2) ≤ Ymin ≤ Y0 Y2 ≤ Ymax ≤ 1.25 Y2	AD01 AD91	AD01 AD91	AD01 AD91
9. Measured variable, output B Same as output A, but markings start with a capital B	BA ...	BA ...	BA ...
10. Output signal, output B Same as output A, but markings start with a capital B	BB ..	BB ..	BB ..
11. Characteristic, output B Same as output A, but markings start with a capital B	BC ..	BC ..	BC ..
12. Limits, output B Same as output A, but markings start with a capital B	BD ..	BD ..	BD ..
13. Measured variable, output C Same as output A, but markings start with a capital C	CA ...	CA ...	CA ...
14. Output signal, output C Same as output A, but markings start with a capital C	CB ..	CB ..	CB ..
15. Characteristic, output C Same as output A, but markings start with a capital C	CC ..	CC ..	CC ..
16. Limits, output C Same as output A, but markings start with a capital C	CD ..	CD ..	CD ..
17. Measured variable, output D Same as output A, but markings start with a capital D	DA ..	DA ..	DA ..
18. Output signal, output D Same as output A, but markings start with a capital D	DB ..	DB ..	DB ..

Table 3 continued on next page!

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Continuation "Table 3: Programming"

DESCRIPTION	A11 ... A16	Application A34	A24 / A44
19. Characteristic, output D Same as output A, but markings start with a capital D	DC ..	DC ..	DC ..
20. Limits, output D Same as output A, but markings start with a capital D	DD ..	DD ..	DD ..
21. Energy meter 1 Not used	EA00	EA00	EA00
I System [Ah] I1 L1 [Ah] I2 L2 [Ah] I3 L3 [Ah]	EA50 — — —	— EA51 EA52 EA53	— EA51 EA52 EA53
S System [VAh] S1 L1 [VAh] S2 L2 [VAh] S3 L3 [VAh]	EA54 — — —	EA54 — — —	EA54 EA55 EA56 EA57
P System (incoming) [Wh] P1 L1 (incoming) [Wh] P2 L2 (incoming) [Wh] P3 L3 (incoming) [Wh]	EA58 — — —	EA58 — — —	EA58 EA59 EA60 EA61
Q System (inductive) [Varh] Q1 L1 (inductive) [Varh] Q2 L2 (inductive) [Varh] Q3 L3 (inductive) [Varh]	EA62 — — —	EA62 — — —	EA62 EA63 EA64 EA65
P System (outgoing) [Wh] P1 L1 (outgoing) [Wh] P2 L2 (outgoing) [Wh] P3 L3 (outgoing) [Wh]	EA66 — — —	EA66 — — —	EA66 EA67 EA68 EA69
Q System (capacitive) [Varh] Q1 L1 (capacitive) [Varh] Q2 L2 (capacitive) [Varh] Q3 L3 (capacitive) [Varh]	EA70 — — —	EA70 — — —	EA70 EA71 EA72 EA73
22. Energy meter 2 Same as energy meter 1, but markings start with a capital F	FA ..	FA ..	FA ..
23. Energy meter 3 Same as energy meter 1, but markings start with a capital G	GA ..	GA ..	GA ..
24. Energy meter 4 Same as energy meter 1, but markings start with a capital H	HA ..	HA ..	HA ..

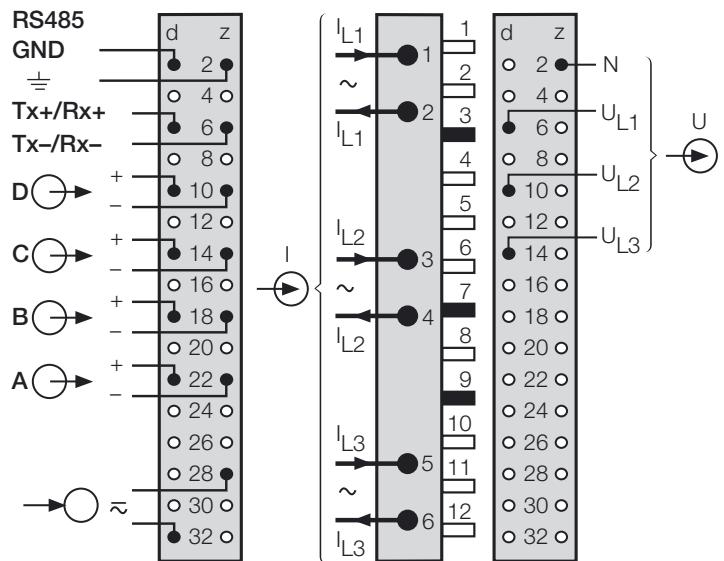
EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Electrical connections

Function		Connect.
Measuring input		
AC current	IL1	1 / 2
	IL2	3 / 4
	IL3	5 / 6
	UL1	6d
AC voltage	UL2	10d
	UL3	14d
	N	2z
Outputs	Analogue	
A	+	22d
	-	22z
B	+	18d
	-	18z
C	+	14d
	-	14z
D	+	10d
	-	10z
RS 485	Tx+/Rx+	6d
(MODBUS)	Tx-/Rx-	6z
	GND	2d
	\pm	2z
Power supply		
AC	\sim	28z
	\sim	32d
DC	+	32d
	-	28z

DME 440 Back



□ Coding pin
■ Coding pin broken out

● Contact fitted
○ No contact

Measuring inputs

System / application	Plug wiring
Single-phase AC system	

EURAX DME 440 with RS 485 interface

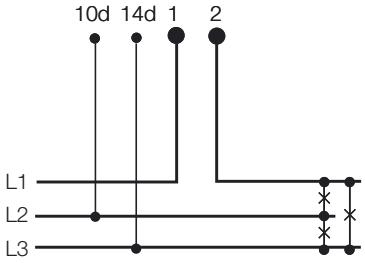
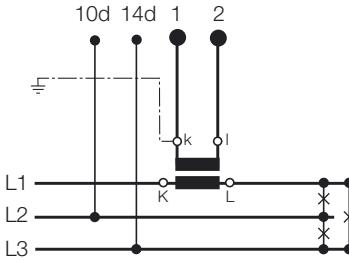
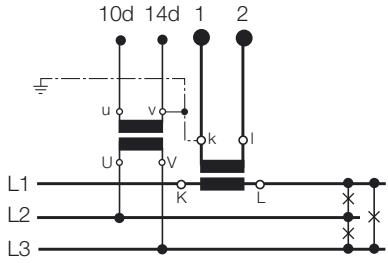
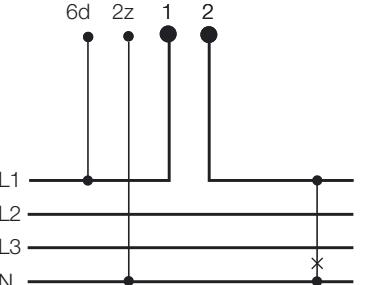
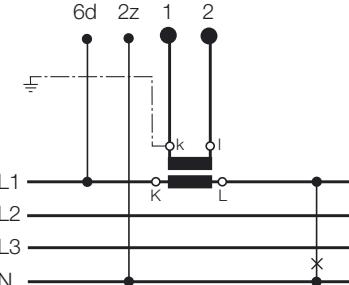
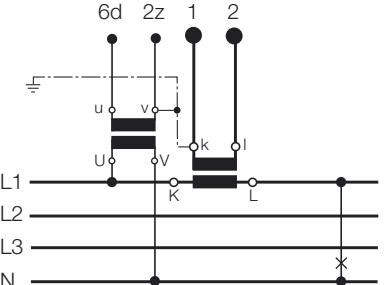
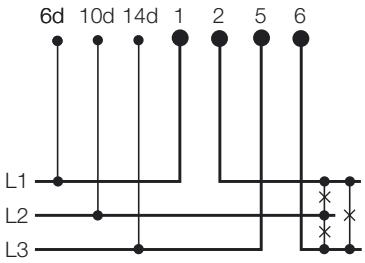
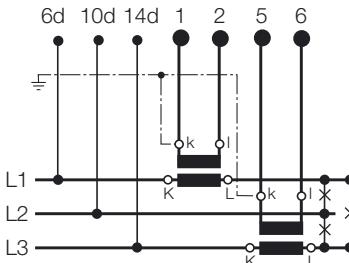
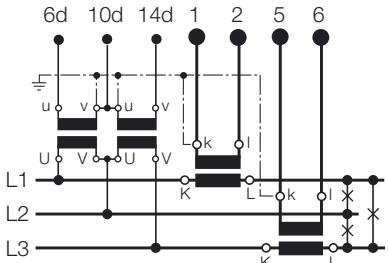
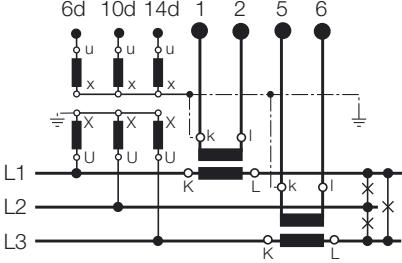
Programmable multi-transducer

Measuring inputs

System / application	Plug wiring		
3-wire 3-phase symmetric load I: L1			
	Connect the voltage according to the following table for current measurement in L2 or L3:		
	Current transformer	Connections	6d 10d 14d
	L2	1 2	L2 L3 L1
	L3	1 2	L3 L1 L2
3-wire 3-phase symmetric load phase-shift U: L1 - L2 I: L1			
	Connect the voltage according to the following table for current measurement in L2 or L3:		
	Current transformer	Connections	6d 10d
	L2	1 2	L2 L3
	L3	1 2	L3 L1
3-wire 3-phase symmetric load phase-shift U: L3 - L1 I: L1			
	Connect the voltage according to the following table for current measurement in L2 or L3:		
	Current transformer	Connections	14d 6d
	L2	1 2	L1 L2
	L3	1 2	L2 L3

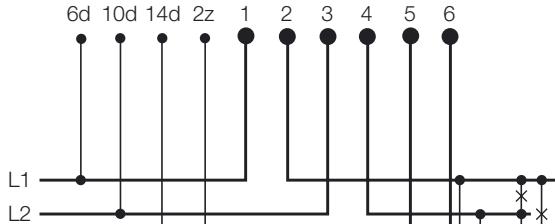
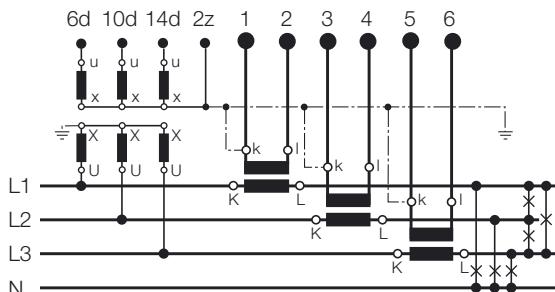
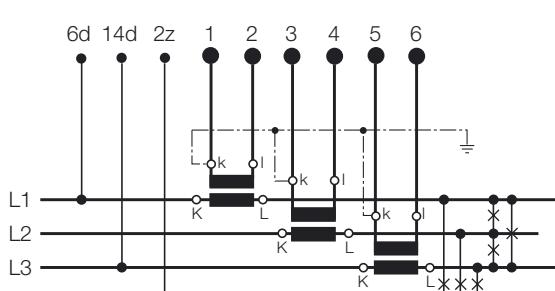
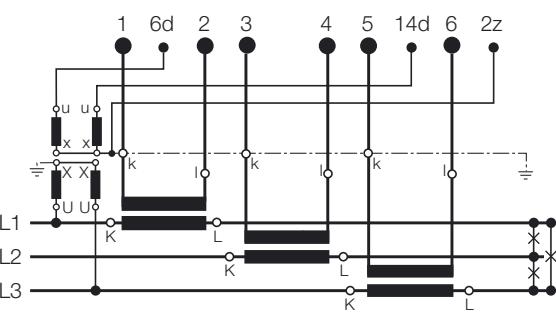
EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Measuring inputs													
System / application	Plug wiring												
3-wire 3-phase symmetric load phase-shift U: L2 – L3 I: L1	   <p>Connect the voltage according to the following table for current measurement in L2 or L3:</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Current transformer</th><th>Connections</th><th>10d</th><th>14d</th></tr> </thead> <tbody> <tr> <td>L2</td><td>1 2</td><td>L3</td><td>L1</td></tr> <tr> <td>L3</td><td>1 2</td><td>L1</td><td>L2</td></tr> </tbody> </table>	Current transformer	Connections	10d	14d	L2	1 2	L3	L1	L3	1 2	L1	L2
Current transformer	Connections	10d	14d										
L2	1 2	L3	L1										
L3	1 2	L1	L2										
4-wire 3-phase symmetric load I: L1	   <p>Connect the voltage according to the following table for current measurement in L2 or L3:</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Current transformer</th><th>Connections</th><th>6d</th><th>2z</th></tr> </thead> <tbody> <tr> <td>L2</td><td>1 2</td><td>L2</td><td>N</td></tr> <tr> <td>L3</td><td>1 2</td><td>L3</td><td>N</td></tr> </tbody> </table>	Current transformer	Connections	6d	2z	L2	1 2	L2	N	L3	1 2	L3	N
Current transformer	Connections	6d	2z										
L2	1 2	L2	N										
L3	1 2	L3	N										
3-wire 3-phase asymmetric load	   												

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Measuring inputs	
System / application	Plug wiring
4-wire 3-phase asymmetric load	  <p>3 single-pole insulated voltage transformers in high-voltage system</p>
4-wire 3-phase asymmetric load, Open-Y connection	  <p>Low-voltage system</p>

Relationship between PF, QF and LF

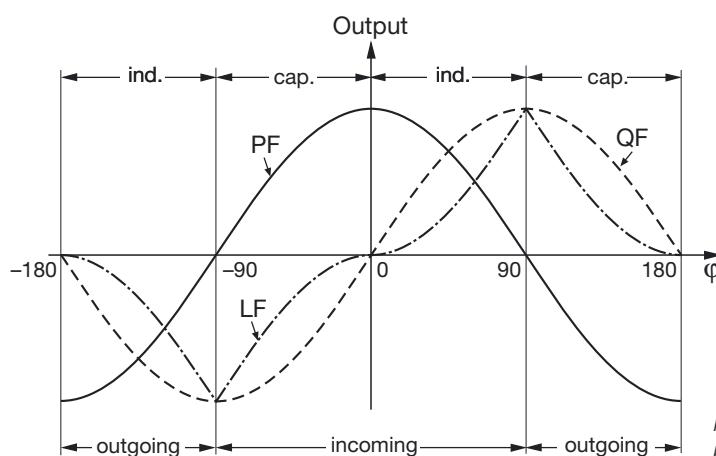


Fig. 5. Active power PF —, reactive power QF -----, power factor LF - - -.

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Connecting devices to the bus

The RS 485 interface of the DME 440 is galvanically isolated from all other circuits. For an optimal data transmission the devices are connected via a 3-wire cable, consisting of a twisted pair cable (for data lines) and a shield. There is no termination required. A shield both prevents the coupling of external noise to the bus and limits emissions from the bus. The shield must be connected to solid ground.

You can connect up to 32 members to the bus (including master). Basically devices of different manufacturers can be connected to the bus, if they use the standard MODBUS® protocol. Devices without galvanically isolated bus interface are not allowed to be connected to the shield.

The optimal topology for the bus is the daysi chain connection from node 1 to node 2 to node n. The bus must form a single continuous path, and the nodes in the middle of the bus must have short stubs. Longer stubs would have a negative impact on signal quality (reflexion at the end). A star or even ring topology is not allowed.

There is no bus termination required due to low data rate. If you got problems when using long cables you can terminate the bus at both ends with the characteristic impedance of the cable (normally about 120Ω). Interface converters RS 232 \leftrightarrow RS 485 or RS 485 interface cards often have a built-in termination network which can be connected to the bus. The second impedance then can be connected directly between the bus terminals of the device far most.

Fig. 6 shows the connection of transducers DME 440 to the MODBUS. The RS 485 interface can be realized by means of PC built-in interface cards or interface converters. Both is shown using i.e. the interfaces 13601 and 86201 of W & T (Wiesemann & Theis GmbH). They are configured for a 2-wire application with automatic control of data direction. These interfaces provide a galvanical isolation and a built-in termination network.

Important:

- Each device connected to the bus must have a unique address
- All devices must be adjusted to the same baudrate.

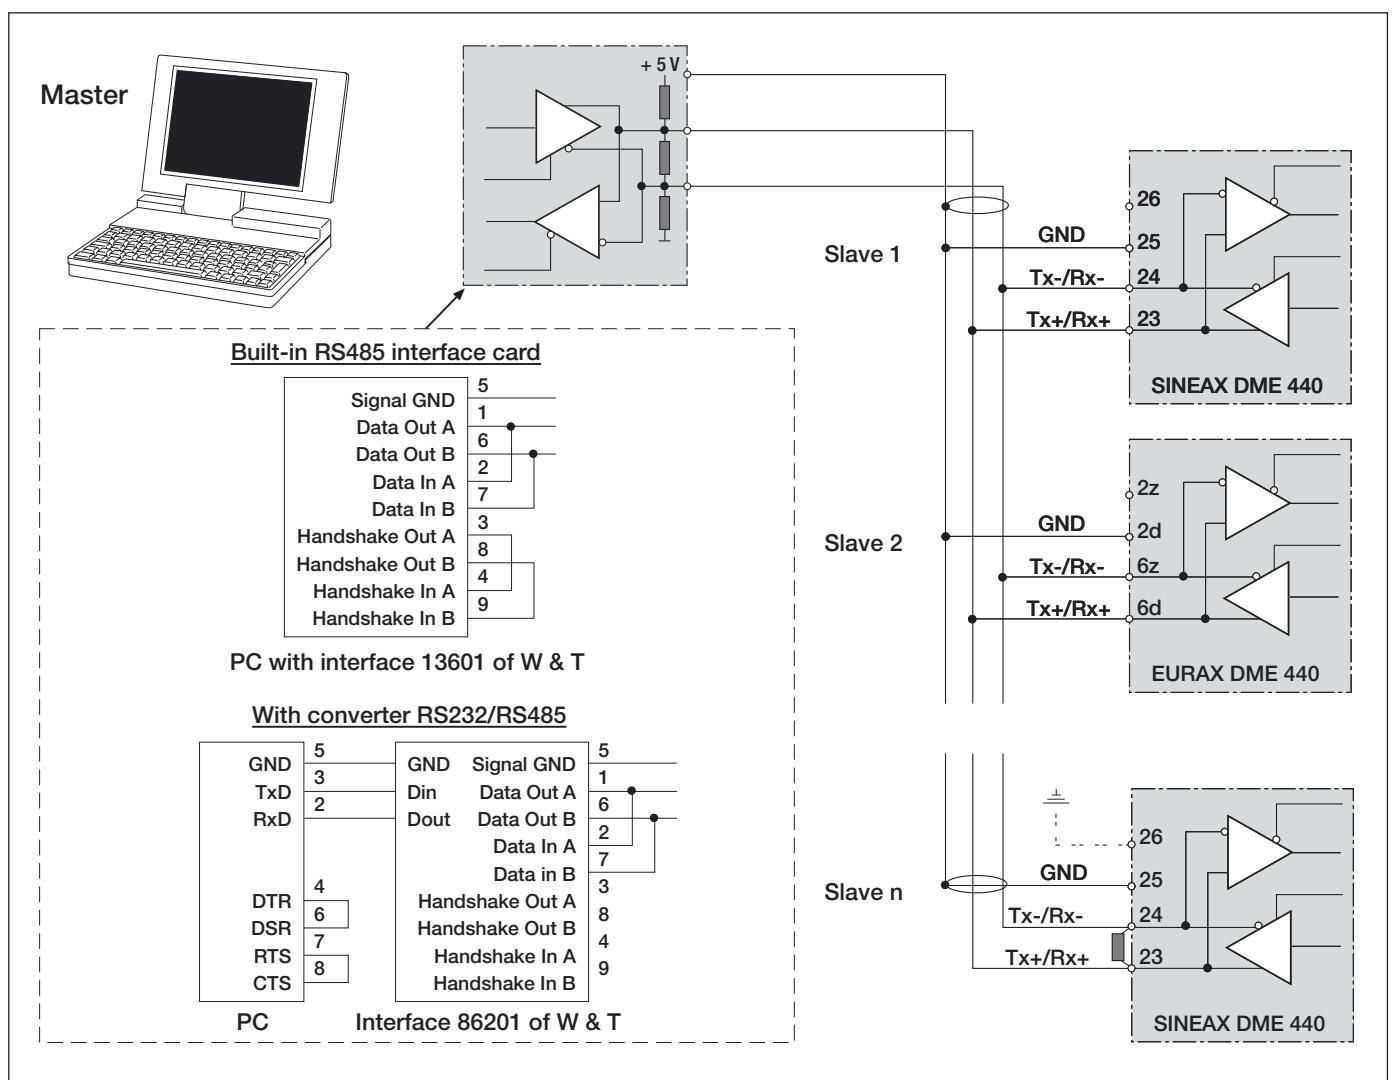


Fig. 6

EURAX DME 440 with RS 485 interface

Programmable multi-transducer

Dimensional drawing

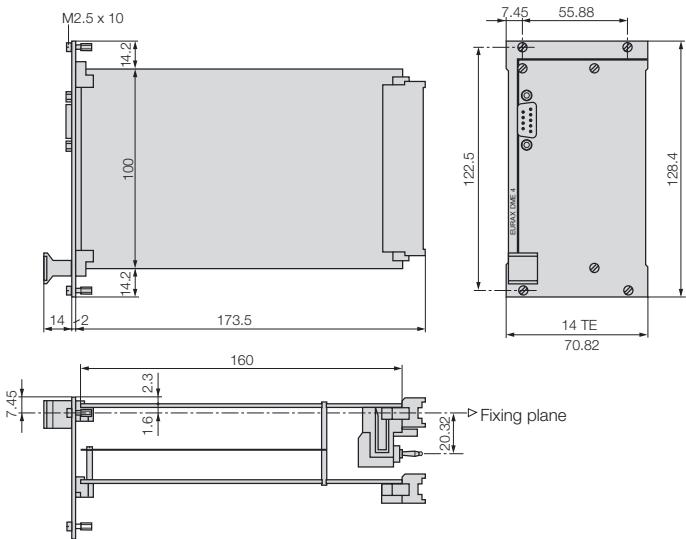


Fig. 7. EURAX DME 440, front plate width **14 TE**.

Table 4: Accessories

Description	Order No.
Programming cable	980 179
Configuration software DME 4 for SINEAX/EURAX DME 424, 440, 442, SINEAX DME 400, 401 and 406 Windows 3.1x, 95, 98, NT and 2000 on CD in German, English, French, Italian and Dutch (Download free of charge under http://www.gmc-instruments.com) In addition, the CD contains all configuration programmes presently available for Camille Bauer products.	146 557
Set for incorporation (incl. 1 coding strip, 3 coding pegs and 8 screws) LV edge connector plug and heavy current edge connector socket for mounting in 19" rack GTU 0509 resp. EURAX BT 901 LV edge connector plug with wire-wrap posts, heavy current edge connector plug with 0,5 m cable	138 885
LV edge connector plug with soldering posts, heavy current edge connector plug with 0,5 m cable	138 869
Operating Instructions DME 440-2 B d-f-e	127 193

Version with GTU front plate to order acc. to NLB 876.

Standard accessories

- 1 Operating Instructions for EURAX DME 440 in three languages:
German, French, English
- 1 blank type label, for recording programmed settings
- 1 Interface definition DME 440: German, French or English

Appendix: PROGRAMMING FOR EURAX TYPE DME 440

with 4 analogue outputs and bus interface RS 485 (MODBUS®)

(see Data Sheet DME 440-2 Le, Table 3: «Programming»)



Customer / Agent: _____

Date: _____

Order No. / Item: _____

Delivery date: _____

No of instruments: _____

Type of instruments (marking): _____

Codes for features 1 to 24:

Features 1 to 24 concern data for configuring the software.

1. Application

A	<input type="checkbox"/>	<input type="checkbox"/>
---	--------------------------	--------------------------

System _____

2. Rated input voltage, rated value

U	<input type="checkbox"/>	<input type="checkbox"/>
---	--------------------------	--------------------------

Ur = _____

3. Rated input current, rated value

V	<input type="checkbox"/>	<input type="checkbox"/>
---	--------------------------	--------------------------

Ir = _____

4. Primary rating

W	<input type="checkbox"/>
---	--------------------------

VT = _____ kV CT = _____ A

Specify transformer ratio primary, e.g. 33 kV, 1000 A

The secondary ratings must correspond to the rated input voltage and current specified for feature 2, respectively 3.

Output A

A	A	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

5. Measured variable Type: _____

X0 = _____ X2 = _____

A	B	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

6. Output signal

Y0 = _____ Y2 = _____

A	C	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

7. Characteristic linear / bent

X1 = _____ Y1 = _____

A	D	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

8. Limits

Standard / Ymin = _____ Ymax = _____

Output B

B	A	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

9. Measured variable Type: _____

X0 = _____ X2 = _____

B	B	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

10. Output signal

Y0 = _____ Y2 = _____

B	C	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

11. Characteristic linear / bent

X1 = _____ Y1 = _____

B	D	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

12. Limits

Standard / Ymin = _____ Ymax = _____

Output C

C	A	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

13. Measured variable Type: _____

X0 = _____ X2 = _____

C	B	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

14. Output signal

Y0 = _____ Y2 = _____

C	C	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

15. Characteristic linear / bent

X1 = _____ Y1 = _____

C	D	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

16. Limits

Standard / Ymin = _____ Ymax = _____

Output D

D	A	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

17. Measured variable Type: _____

X0 = _____ X2 = _____

D	B	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

18. Output signal

Y0 = _____ Y2 = _____

D	C	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

19. Characteristic linear / bent

X1 = _____ Y1 = _____

D	D	<input type="checkbox"/>	<input type="checkbox"/>
---	---	--------------------------	--------------------------

20. Limits

Standard / Ymin = _____ Ymax = _____

Continued on next page!

E A			21. Energy meter 1
F A			22. Energy meter 2
G A			23. Energy meter 3
H A			24. Energy meter 4